



INSTRUCTIONS POUR DÉTERMINER SI VOTRE COMBINAISON D'UNITÉ A UNE CERTIFICATION ENERGY STAR

MINIMUM REQUIS POUR ENERGY STAR
15 SEER - 12,5 EER - 8,5 H.S.P.F

ÉTAPE 1
VISITEZ LE SITE WWW.GOARCOIRE.COM

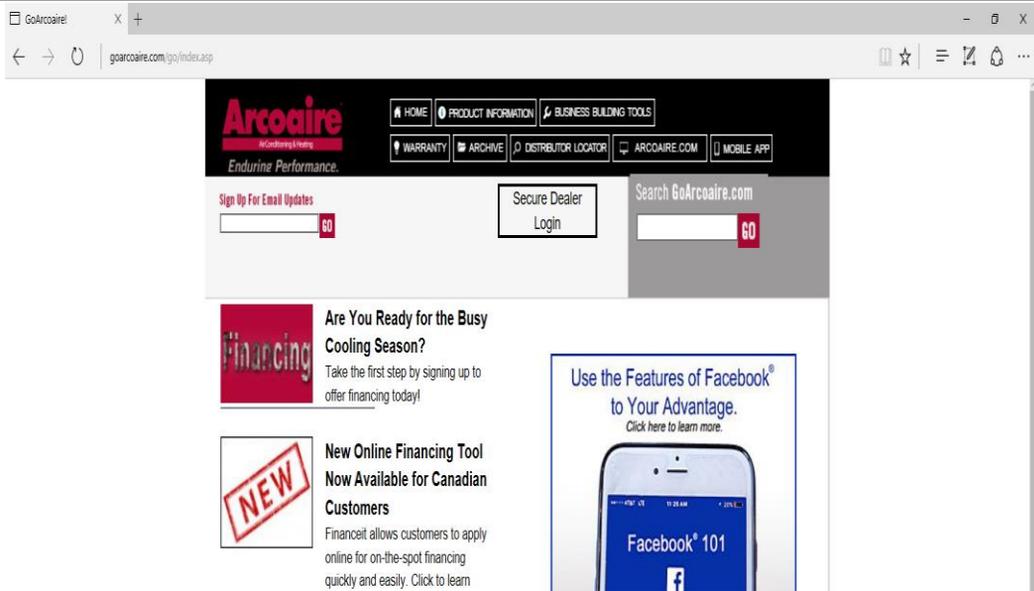

ÉTAPE 2
DÉPLACEZ VOTRE CURSEUR SUR L'ONGLET (PRODUCT INFORMATION)
ET CLIQUEZ SUR L'ONGLET
(COMBINATION RATING DATABASE)

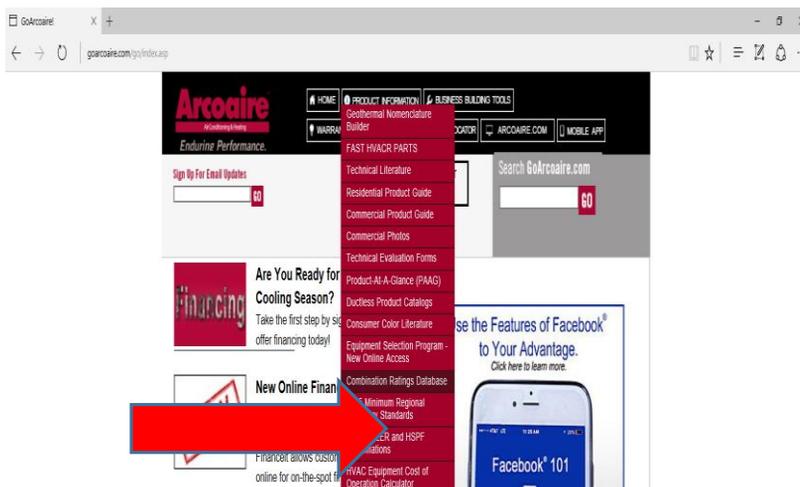

ÉTAPE 3

ENTREZ LES MODÈLES DES UNITÉS INTÉRIEUR ET EXTÉRIEUR
DANS LES CASES APPROPRIÉES.

GoArcoaire! icpeqp.com

icpeqp.com/AHRIratings/ratings.aspx?Brand=Arcoaire

Arcoaire
Air Conditioning & Heating

AHRI Ratings & Tax Credit Certification

AC HP Ductless AC Ductless HP
 Res_Pkg AC Res_Pkg HP Geo Water to Air Geo Water to Water

Active Discontinued Archived

Tonnage: All

Phase: 1

Outdoor Model: **HSH536(A,G)KA**** (indicated by a red arrow)

Indoor Coil Series: All

Indoor Coil Model: All

Furnace Series: All

Furnace Model: All

Minimum SEER: 13.0

Electrical Data
HSH424GKA**
MCA - 17.6 amps
MOCP - 25 amps

ÉTAPE 4

SI VOTRE COMBINAISON À LES DONNÉES ÉQUIVALENTES OU
SUPÉRIEURS À 15 SEER -12,5 EER – 8,5 H.S.P.F DES OPTIONS AVEC LE
NUMÉRO AHRI VONT APPARAÎTRE DANS LE BAS DE VOTRE PAGE

GoArcoaire! icpeqp.com

icpeqp.com/AHRIratings/ratings.aspx?Brand=Arcoaire

Arcoaire
Air Conditioning & Heating

AHRI Ratings & Tax Credit Certification

AC HP Ductless AC Ductless HP
 Res_Pkg AC Res_Pkg HP Geo Water to Air Geo Water to Water

Active Discontinued Archived

Tonnage: All

Phase: 1

Outdoor Model: HSH536(A,G)KA**

Indoor Coil Series: FXM4X

Indoor Coil Model: All

Minimum SEER: 13.0

AHRI Directory of Certified Product Performance

To obtain an AHRI Certificate

1. Copy Reference Number
2. Press button below to go to the AHRI website
3. Paste Reference Number in Reference Text box and press [Search] (enter code in picture if needed)
4. Double click rating line.

[AHRI Website Search](#)

Note: Discontinued combinations may no longer appear on AHRI – email AHRI for a letter instead

Electrical Data
MCA -
MOCP -

Data was current with AHRI as of Sunday, February 12, 2017. Values are subject to change without notice.

	AHRI Ref #	Status	Outdoor Model	Indoor Model	Furnace Cap	EER	SEER	Cap 47°	HSPF	Cap 17°		
<input type="button" value="Print"/>	<input type="button" value="Tax"/>	<input type="button" value="Copy"/>	9628333	Active	HSH536(A,G)KA**	FXM4X36**AL	35200	12.5	15	34200	8.5	21800
<input type="button" value="Print"/>	<input type="button" value="Copy"/>	9628352	Active	HSH536(A,G)KA**	FXM4X42**AL	35000	12	14.5	34200	8.5	21800	

Posiez-moi une question.

ÉTAPE 5

VISITEZ LE SITE WWW.CEEDIRECTORY.ORG
ET CLIQUEZ SUR LA SECTION CONCERNÉE.

CEE Directory of Efficient Equipment

Search the CEE Tiers for efficient equipment for your home or business.

Residential Furnaces

Residential Boilers

Variable Speed Mini-Split and Multi-Split Heat Pumps

Residential Water Heaters

Split or Packaged Air Conditioners

Variable Speed Mini-Split and Multi-Split Air Conditioners

Commercial Water Heaters

Home

Find an Incentive Program

Why Choose ENERGY STAR

How and Why of Certified

ENERGY STAR

CEE

ÉTAPE 6

ENTREZ LE NUMÉRO AHRI ET LE CODE FOURNIS DANS LA CASE
AU DESSUS DE L'ONGLET SEARCH (EN BAS À DROITE) ET
CLIQUEZ SUR SEARCH.

CEE Directory of Efficient Eq

HP Search

ahridirectory.org/ahridirectory/pages/hp/cee/defaultSearch.aspx

CEE

AHRI CERTIFIED

Home

AHRI Certified Reference Number 9628333

CEE Tiers All

AHRI Type Please Select an AHRI Type

Outdoor Unit Manufacturer (Systems) Please Select a Manufacturer

Indoor Coil Manufacturer (Mix-match Or Coil) Please Select a Manufacturer

Furnace Model Number

SEER (Btu/Watt) Min. Max.

High Temp Heating 47°F Capacity (Btuh) Min. Max.

Low Temp Heating 17°F Capacity (Btuh) Min. Max.

Manufacturer Type OEM and Third Party Coils

Labeled ENERGY STAR Yes No No Preference

Equipment Type

Model Status

Outdoor Unit Model Number

Outdoor Unit Trade/Brand Name (Systems) Please Select an Outdoor Unit Trade/Brand Name

Indoor Unit Model Number

Cooling Cap (Btuh) Min. Max.

EER (Btu/Watt) Min. Max.

HSPF (Btu/Watt.h) Min. Max.

Phase 1-Phase

Product Type Split and Packaged

XYR7JT

To Continue enter the code in the picture above XYR7JT


Search Reset

By clicking the Search Button, I agree to the Terms and Conditions.

10 sur 24 - Presse-Papiers. Éléments non ajoutés: Supprimer des éléments pour augmenter l'espace disponible.

ÉTAPE 7

SI LE MOT (YES) APPARAÎT DANS LA CASE LABELED ENERGY STAR
VOTRE COMBINAISON D'UNITÉ EST BIEN APPROUVÉE ENERGY
STAR.

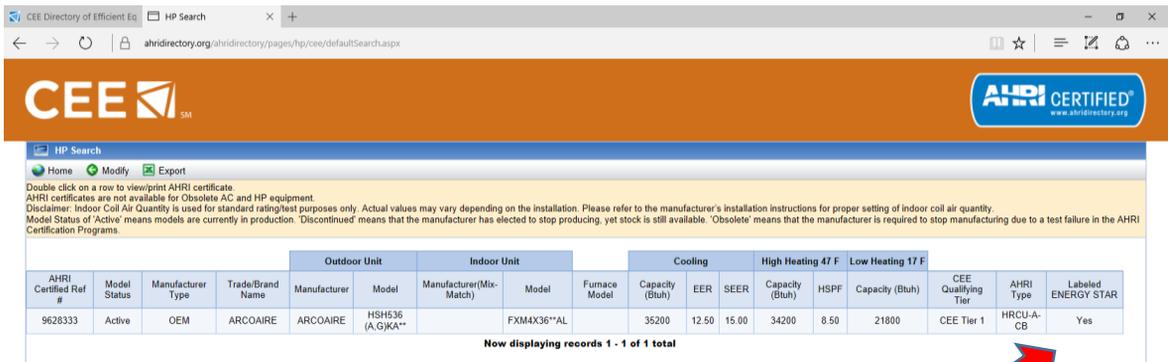

Double click on a row to view/print AHRI certificate.
AHRI certificates are not available for Obsolete AC and HP equipment.
Disclaimer: Indoor Coil Air Quantity is used for standard rating/test purposes only. Actual values may vary depending on the installation. Please refer to the manufacturer's installation instructions for proper setting of indoor coil air quantity.
Model Status of 'Active' means models are currently in production. 'Discontinued' means that the manufacturer has elected to stop producing, yet stock is still available. 'Obsolete' means that the manufacturer is required to stop manufacturing due to a test failure in the AHRI Certification Programs.

AHRI Certified Ref #	Model Status	Manufacturer Type	Trade/Brand Name	Outdoor Unit		Indoor Unit		Furnace Model	Cooling			High Heating 47 F		Low Heating 17 F		CEE Qualifying Tier	AHRI Type	Labeled ENERGY STAR
				Manufacturer	Model	Manufacturer(Mix-Match)	Model		Capacity (Btuh)	EER	SEER	Capacity (Btuh)	HSPF	Capacity (Btuh)				
9628333	Active	OEM	ARCOAIRE	ARCOAIRE	HS1536 (A,G)KA**		FXM4X36**AL		35200	12.50	15.00	34200	8.50	21800	CEE Tier 1	HRCU-A-CB	Yes	

Now displaying records 1 - 1 of 1 total

POUR TOUTE QUESTION
S.V.P CONTACTEZ
UN DE NOS COMMIS.

FIN